Ref. Certif. No.

CN47984-M1

IEC SYSTEM FOR MUTUAL RECOGNITION OF TEST CERTIFICATES FOR ELECTRICAL EQUIPMENT (IECEE) CB SCHEME

CB TEST CERTIFICATE

Product	Switch-disconnectors
Name and address of the applicant	Zhejiang CHINT Electrics Co., Ltd. No.1, CHINT Road, CHINT Industrial Zone, North Baixiang Town, Yueqing City, Zhejiang Province, P.R.China
Name and address of the manufacturer	Zhejiang CHINT Electrics Co., Ltd. No.1, CHINT Road, CHINT Industrial Zone, North Baixiang Town, Yueqing City, Zhejiang Province, P.R.China
Name and address of the factory Note: *When more than one factory, please report on page 2*	NOARK Electrics (Shanghai) Co., Ltd. No.3857 Sixian Road, Songjiang District, Shanghai, P.R.China
Ratings and principal characteristics	See the Appendix
Trademark (if any)	CHINT
Customer's Testing Facility (CTF) Stage used	
Model / Type Ref.	NM8NSD-125
Additional information (if necessary may also be reported on page 2)	
A sample of the product was tested and found to be in conformity with	IEC 60947-1:2007 (5th Edition) + AMD1:2010 + AMD2:2014;IEC 60947-3:2008(3rd Edition) + AMD 1:2012 + AMD 2:2015
As shown in the Test Report Ref. No. which forms part of this Certificate	00901-CB2019CQC-085606-M1

This CB Test Certificate is issued by the National Certification Body

CHINA QUALITY CERTIFICATION CENTRE

Section 9, No. 188 Nansihuan Xilu, Beijing 100070 P. R. China
Tel: +86-10-83886666 Fax: +86-10-83886282
website: http://www.cqc.com.cn

Date: Oct.21,2019

Signature: Lu Mei

CB 0054331

NM8NSD-125
Uimp: 8kV;
Ui: 1000V;
Ith: 63A,100A,125A;
Ue: AC240V(1P), AC690V(2P, 3P,4P), DC250V(1P appearance), DC500V(2P appearance), DC750V(3P appearance),DC1000V(4P appearance);
Ie: 63A,100A,125A;
Icw: 2kA/1s, 2kA/3s;
Icm(AC): 3.2kA;
Icm(DC): 2kA;
AC-22A,AC-23A, DC-22A,DC-23A, DC-PV2;
1P, 2P, 3P, 4P;
IP20;
50/60Hz;
Auxiliary contact and alarm contact AX21-M8 and AL21-M8(CN46412-M1)
1NO1NC
Ith: 5A;
AC-15: Ue/Ie: AC110V/5A, AC240V/4A, AC415V/2A;
DC-13: Ue/Ie: DC110V/0.25A, DC220V/0.25A;

Additional information (if necessary)

Date: Oct.21,2019

Signature: Lu Mei

CHINA QUALITY CERTIFICATION CENTRE
Section 9, No. 188 Nansihuan Xilu, Beijing 100070 P. R. China
Tel: +86-10-83886666
Fax: +86-10-83886282
website
http://www.cqc.com.cn

Connection diagram for DC product:

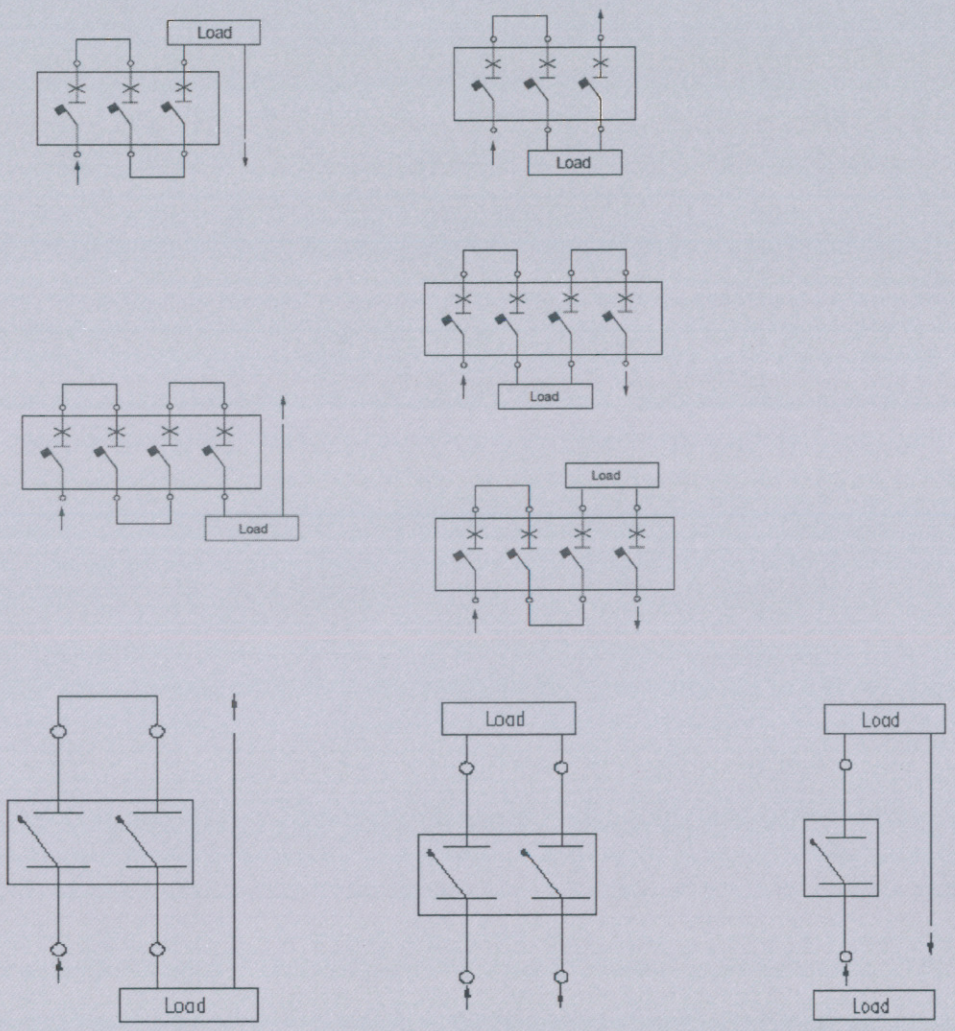

All wiring diagram are applicable to up-side wiring and/or under-side wiring

Additional information (if necessary)

Date: Oct.21,2019

Signature: Lu Mei

CHINA QUALITY CERTIFICATION CENTRE
Section 9, No. 188 Nansihuan Xilu, Beijing 100070 P. R. China
Tel: +86-10-83886666
Fax: +86-10-83886282
website
http://www.cqc.com.cn